
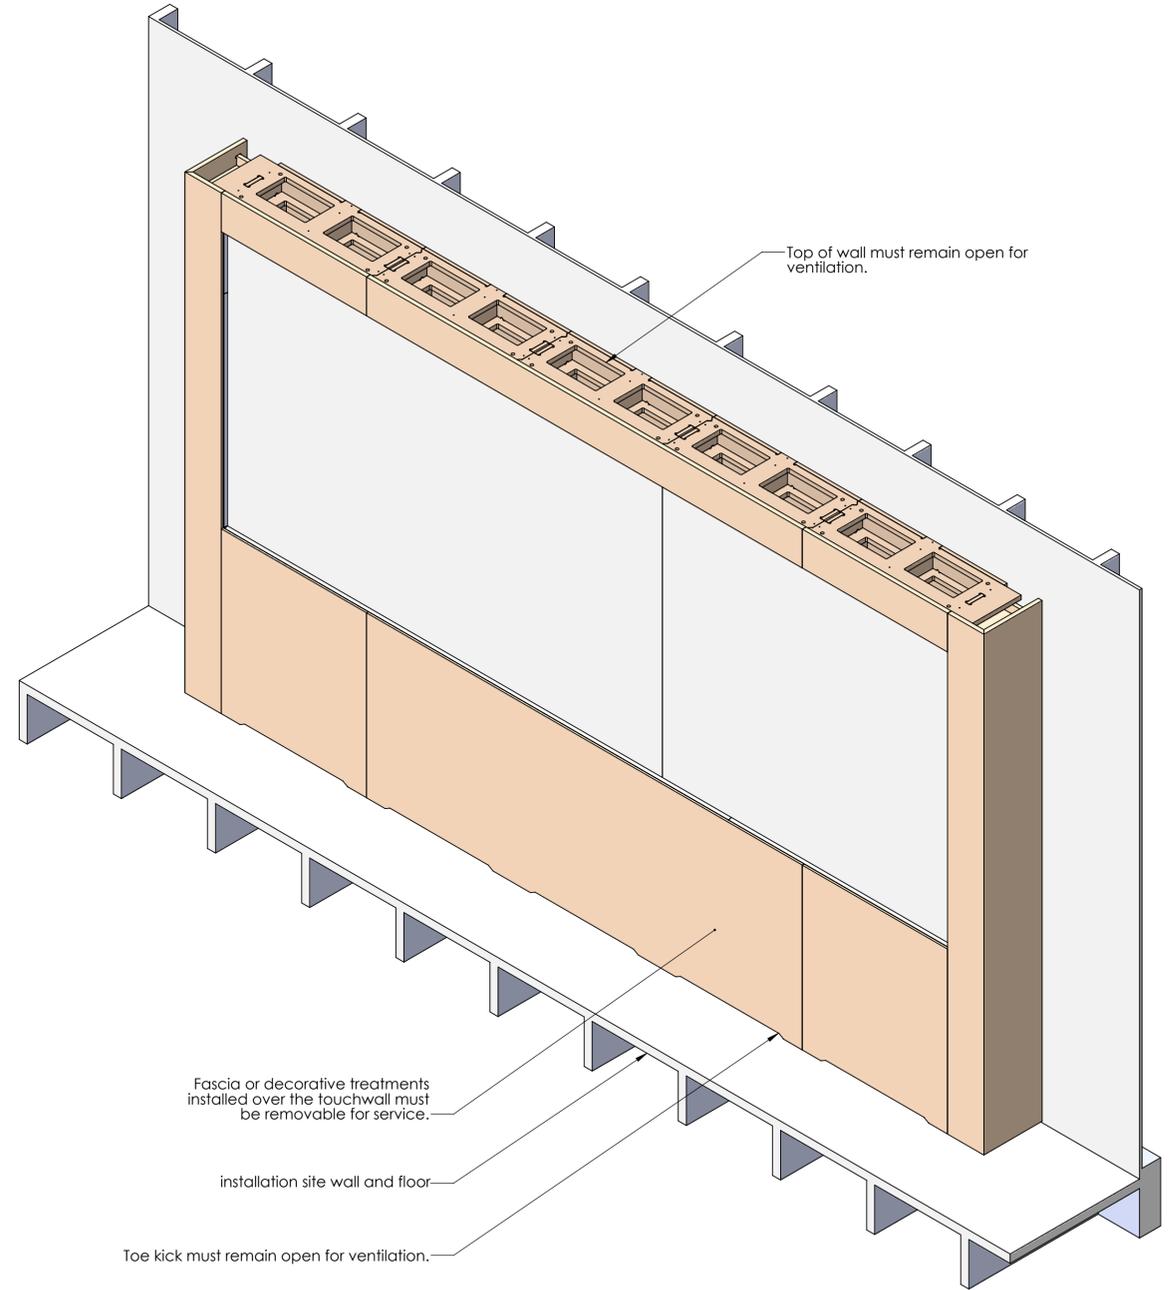
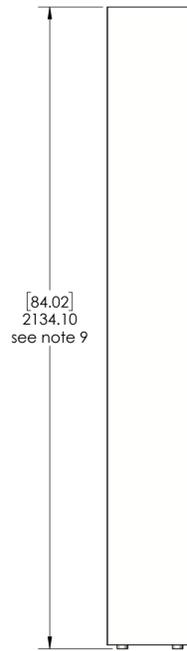
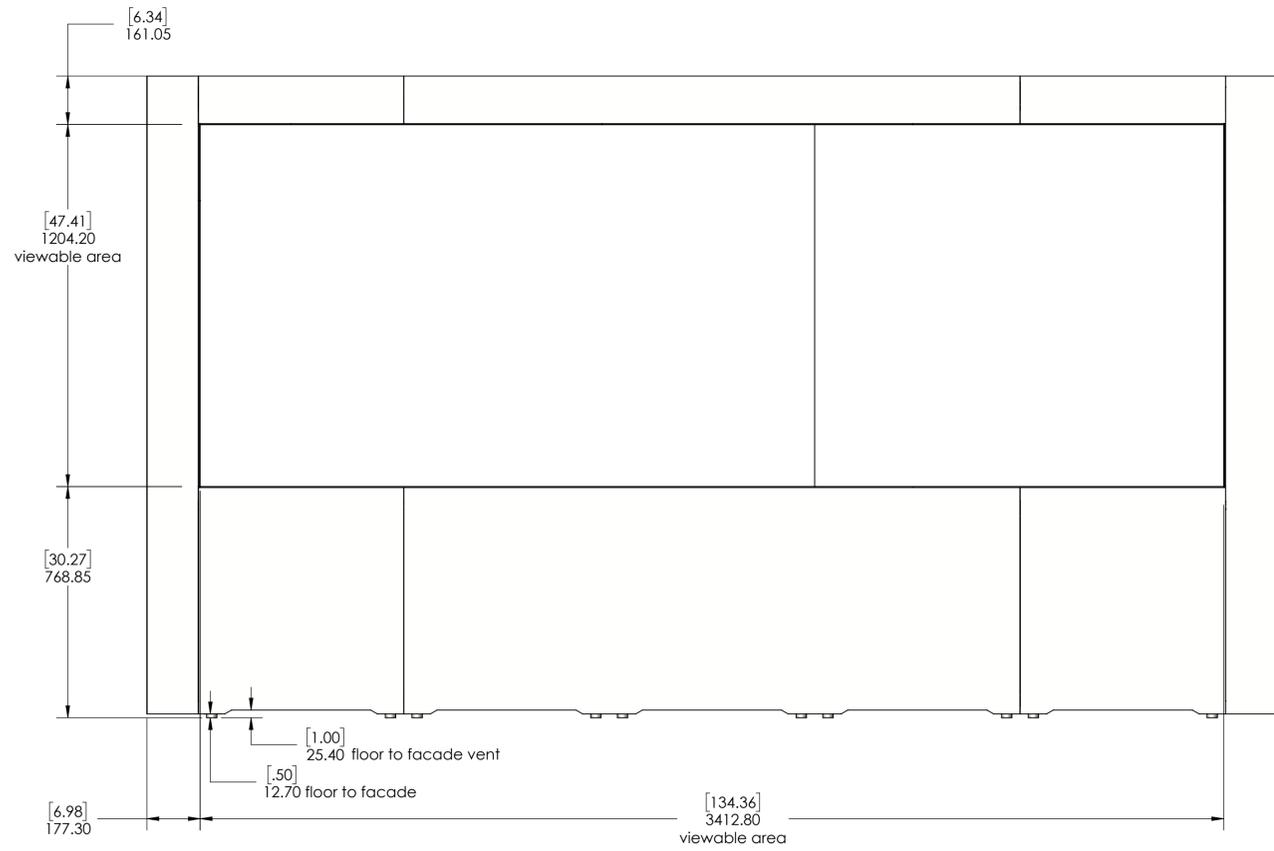


- NOTE:
- 2x 110v, 20A circuits
 - 1x CAT5 data line
 - If the CPU is to be located remotely, inquire about TIV's CPU rack module
 - If the rack module is to be used, structured wiring requirements will differ from those listed above.
 - Allow at least 1" space on either side of device when recessing into a wall.
 - Top and bottom must remain ventilated as indicated. Allow 3" above, open to front or back unless ventilated into wall and plenum above.
 - Facade panels included with wall system pop off to the front with a hard pull. Many facade treatments may be attached to these panels directly. Any facade treatments must be removable for service regardless of installation method.
 - Facade treatments should extend to the visible area.
 - Device must be installed completely flat, vertical and level. Shimming or leveler adjustment may be required which will increase installed thickness or height. Leave allowance accordingly when recessing this device into a wall and allow for facade treatments to be trimmed to field measurements.

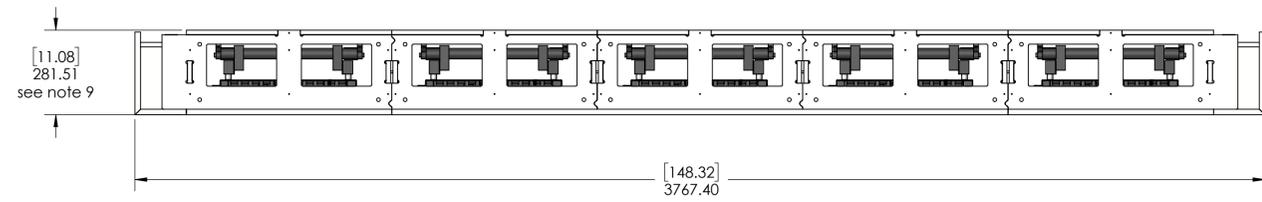

PROPRIETARY AND CONFIDENTIAL
 THE INFORMATION CONTAINED IN THIS DRAWING
 IS THE SOLE PROPERTY OF TIV, INC. ANY
 REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE
 WRITTEN PERMISSION OF TIV, INC. IS PROHIBITED.

SKU: SF-OT8-555x1PF-UB WP-OT8-555x1P-UB	UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES TOLERANCES: FRACTIONAL ± ANGULAR: MATCH ± BEND ± TWO PLACE DECIMAL ± THREE PLACE DECIMAL ±	DRAWN CHECKED ENG APPR. MFG APPR. Q.A.	NAME GOB	DATE 2/21/18
APPLICATION	MATERIAL THICKNESS	DO NOT SCALE		SCALE: 1:12 WEIGHT:

TIV

TITLE: WP555

VERSION: 2

SIZE: D

SHEET 1 OF 1